


WORK BY OTHERS

- TO BE PROVIDED BY OWNER AND/OR GENERAL CONTRACTOR:**
- Legal hoistway of proper size, plumb within 1" per 100', and pit of proper depth.
 - A 12" square blackout in elevator pit floor, to be filled when plunger assembly has been installed.(X3)
 - 10" PVC cylinder casing per drawings.(X3)
 - Suitable machine room with legal access & clearances, properly heated & ventilated. Temperature not to exceed 35°C(95°F).
 - Hoistway guard & barricades during installation.
 - Supports for rail fastenings where specified.
 - Venting of hoistways as required by code.
 - All cutting of walls, floors, of partitions together with all repairs, grouting, patching, and painting made necessary by such cutting or changes.
 - Heavy duty fused main line switch in machine room for each elevator with feeders connected to each controller.
 - Lights, light switch, and convenience outlets in elevator machine room.
 - 120V/1Ø/20amp service & telephone outlet for each elevator connected to controller(s) in elevator machine room for car lights & accessories.
 - Light, light switch, and convenience outlet in elevator pit where required.
 - Finished cab floor coverings.
 - All other equipment necessary & not otherwise called for in elevator contract.


NOTE:

PROVIDE WALL CONSTRUCTION SUITABLE FOR ATTACHMENT OF RAIL BRACKETS MIN. DOUBLE 2 x 12 THE FULL WIDTH OF HOISTWAY AT ELEVATIONS SHOWN. MUST BE CAPABLE OF 300# PULLOUT LOADING WITH MAX DEFLECTION OF 1/8"

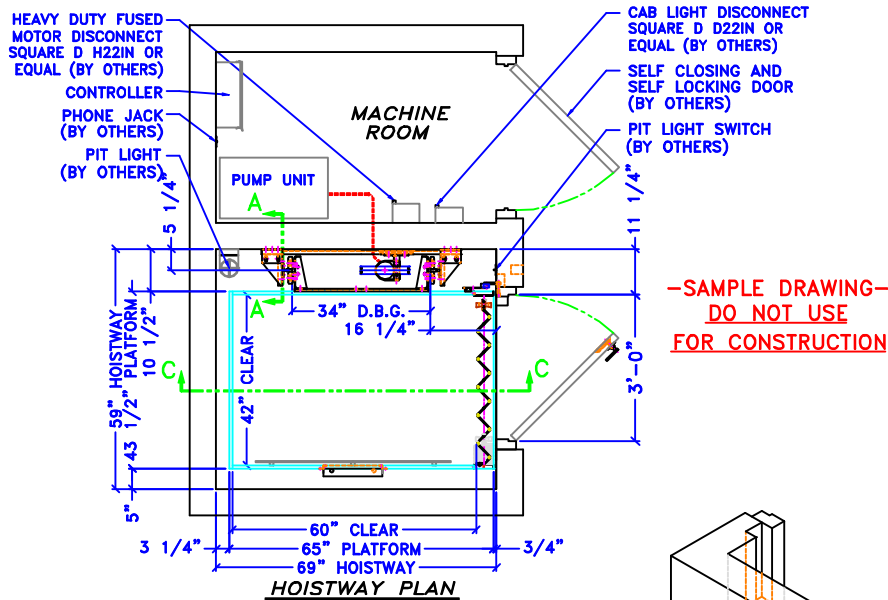


-SAMPLE DRAWING-
DO NOT USE
FOR CONSTRUCTION

-SAMPLE DRAWING-
DO NOT USE
FOR CONSTRUCTION

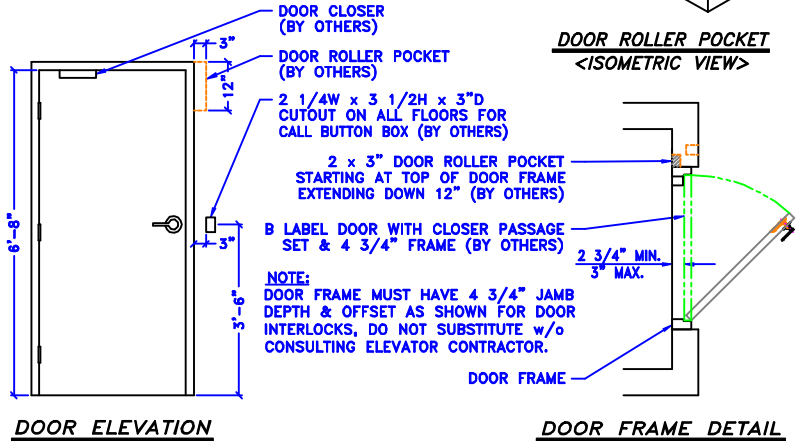

DOOR FRAME DETAIL

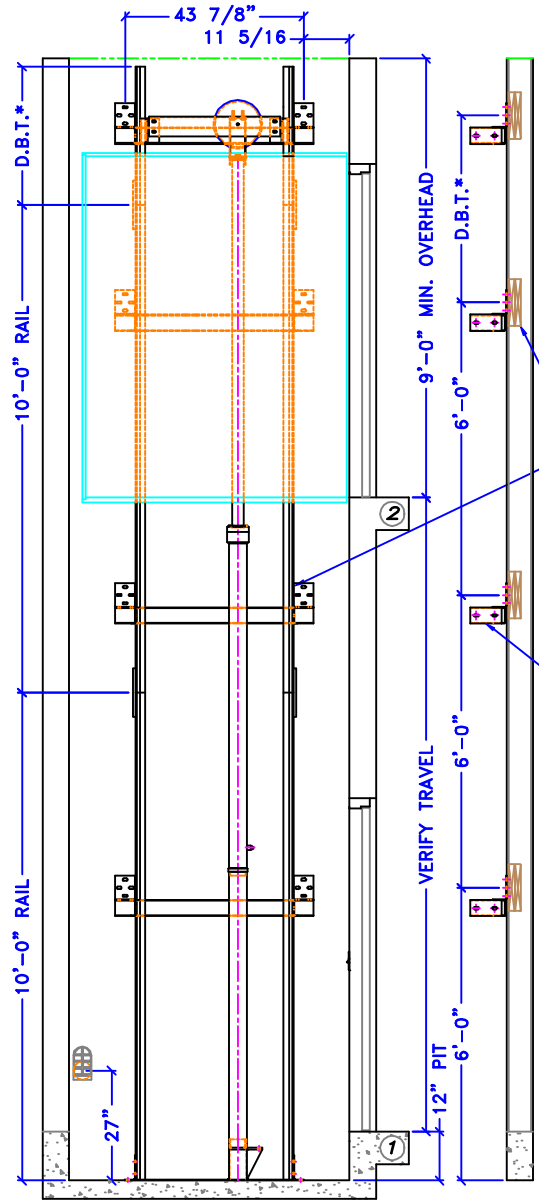

-SAMPLE DRAWING-
DO NOT USE
FOR CONSTRUCTION

-SAMPLE DRAWING-
DO NOT USE
FOR CONSTRUCTION

C-C HOISTWAY ELEVATION (A-A) BRACKET LOCATIONS
*DETERMINED BY TRAVEL

TIGER LIFT			
MODEL	X5	SERVICE	8FD
SPEED	28 FPM	CAPACITY	700
TRAVEL	VERIFY	OPERATION	SPR
NO. LANDINGS	2	NO. CAR GATES	1
CAB TYPE	STD	CAB COLOR	?
HANDRAIL TYPE	ALUMINUM	CEILING COLOR	WHITE
GATE TYPE	WOODFOLD	GATE FINISH	OK WVL
GATE OPERATION	MANUAL	GATE SIZE	36"R
FLOOR DESIGNATION	1, 2	FIXTURE FINISH	SS#4
ILLUMINATE	X EMERG. LIGHT	MICROPRO.	
SCREW PUMP	AUTO LIGHT	RET. CAM	
FIRE SERVICE	RUPTURE VALVE	IN USE LT	
KEY SW/MOMENT	AUTO LOWER	TANK HT.	
ARRIVAL LIGHT	KEY SW/MAINT	AUTO DOOR	
ARRIVAL GONG	CAR TOP STATION	AUTO GATE	
DOOR MONITOR	POSITION IND.	SOFTWARE	
PHONE	PHONE BOX	HARDWARE	
CAR WEIGHT	-	GROSS WEIGHT	-
RAIL SIZE	Ø	PLUNGER DIAMETER	2.75
MOTOR HP	3.5	PLUNGER WALL	250
MOTOR RPM	1750	MIN. PSI	-
VALVE MODEL	KVIP	MAX. PSI	-
PUMP MODEL	20-38	SAFETY MODEL	ED1-A
PUMP GPM	4.33	HOIST CABLE	3/8 Bx19
FEED PIPE	1/2	LINE VOLTAGE	208 1Ø
BUFFER CAPACITY	750	CONTROL VOLTAGE	24
BUFFER STROKE	2.25	MOTOR STARTING	55
PLATEN EXT.(X3)	-	MOTOR RUNNING	17
INTERLOCK Ø1	SM RH 90°	INTERLOCK Ø2	SM RH 90°

ELEVATOR CONCEPTS LTD
18720 KRAUSE RIVERVIEW, MI. 48192

(734)-246-4700
ELEVATORCONCEPTS.COM

JOB NAME: WOODFOLD Ø 2 - 42 x 60
ADDRESS: -
CITY: -
ARCHITECT: -
CONTRACTOR: -
CUSTOMER: -
REVISIONS: -
DRAWN: DJB DATE: 04/24/01 DWG# 34_4280WF2